

BID ADDENDUM NO. (3)

3/9/2026

Prattsburgh Central School District
2025 Capital Improvements Project
2716-043

(SED #57-23-01-04-0-001-034 – Main Building)
(SED #57-23-01-04-0-008-012 – Agricultural Building)
(SED #57-23-01-04-0-002-012 – Auxiliary Building)
(SED #57-23-01-04-7012-001 – Toilet Room Facility)
(SED #57-23-01-04-2-005-001 – Home Dugout)

The following Addendum items shall be considered a part of the contract documents prepared by HUNT ENGINEERS, ARCHITECTS, LAND SURVEYORS & LANDSCAPE ARCHITECT, DPC. Bid Document date of (12/18/2025).

Clarifications issued by this Addendum:

- 1. THIS ADDENDUM CHANGES THE BID OPENING DATE TO MARCH 26th.**

Project Manual Sections issued by this Addendum:

12 35 53.13 – Metal Laboratory Casework

Drawings issued by this Addendum:

MB-E3.2 – SCHEDULES & DETAILS

AG-A6.1 – ROOF PLAN

AD3-A1 - ADDITIONAL REFERENCE MATERIAL PLAY GYM

AD3-H1 – GREENHOUSE MECHANICAL PLANS

AG-A1.2 - ENLARGED RESTROOM PLAN, ELEVATION AND SCHEDULES

Revisions to Project Manual issued by this Addendum:

ITEM AD3-1 Refer to Section 00 11 13 -Advertisement For Bids

AMEND Paragraph 3 to read as: “Sealed bids will be received by the OWNER until 3:30 P.M. local time on March 26th, 2026 at Prattsburgh Central School District, Auxiliary Building Prattsburgh, NY 14873, at which time and place all bids will be opened and publicly read aloud.”

ITEM AD3-2 Refer to Section 12 35 53.13 – Metal Laboratory Casework

ADD Specification 12 35 53.13 – Metal Laboratory Casework, issued by addendum.

Revisions to Drawings issued by this Addendum:

ITEM AD3-3 Refer to Drawing L2.1 – SITE IMPROVEMENT PLAN

AMEND Site Improvement Note 24 to read: “PROVIDE 25’ ROUND POLE (GARDCO SRA-STB-5-188-25-D1-DT5-BK-GFI) AND QTY (3X) POLE MOUNTED FIXTURES (GARDCO #OPF-L-A16-840-T4M-AR1-UNV-BL50-BK) PER POLE LOCATION AND POSITION THE FIXTURE HEADS 90 DEGREES APART ON POLE AS SHOWN. PROVIDE HAND HOLE FOR SECURITY CAMERAS, HEIGHT TO BE VERIFIED IN FIELD. PROVIDE POLE BASES, SEE ELECTRICAL PLANS AND SITE DETAIL 9/L6

ITEM AD3-4 MB-A1.7 – FIRST FLOOR PLAN AREA C

ADD Drawing AD3-A1 ADDITIONAL REFERENCE MATERIAL PLAY GYM as issued by this addendum.

ITEM AD3-5 Refer to Drawing MB-E3.2 – SCHEDULES & DETAILS

DELETE MB-E3.1 – SCHEDULES & DETAILS in its entirety.

ADD MB-E3.1 – SCHEDULES & DETAILS, issued by this addendum.

ITEM AD3-6 Refer to Drawing AG-A1.2 – ENLARGED RESTROOM PLAN, ELEVATIONS AND SCHEDULES

ADD Drawing AG-A1.2 – ENLARGED RESTROOM PLAN, ELEVATIONS AND SCHEDULES as issued but this addendum.

ITEM AD3-7 Refer to Drawing AG-A6.1 – ROOF PLAN

DELETE Drawing AG-A6.1 – ROOF PLAN in its entirety.

ADD Drawing AG-A65.1 – ROOF PLAN as issued by this addendum.

ITEM AD3-8 Refer to Drawing AG-H1.1 – HVAC DEMOLITION & NEW WORK PLAN

ADD Drawing AD3-H1 – GREENHOUSE MECHANICAL PLANS as issued by this addendum.

ITEM AD3-9 Refer to Drawing AG-H1.1 – HVAC DEMOLITION & NEW WORK PLAN

ADD Drawing AD3-H1 – GREENHOUSE MECHANICAL PLANS as issued by this addendum.

End of Addendum (3)

SECTION 12 35 53.13
METAL LABORATORY CASEWORK

PART 1 GENERAL

1.1 SECTION INCLUDES

- A. Standard and custom metal cabinets and cabinet hardware.
- B. Wall shelving.

1.2 RELATED REQUIREMENTS

- A. Section 12 36 00 - Countertops: Additional requirements for countertops.

1.3 REFERENCE STANDARDS

- A. ASTM A666/A666M - Standard Specification for Annealed or Cold-Worked Austenitic Stainless Steel Sheet, Strip, Plate, and Flat Bar; 2024.
- B. ASTM A1008/A1008M - Standard Specification for Steel, Sheet, Cold-Rolled, Carbon, Structural, High-Strength Low-Alloy, High-Strength Low-Alloy with Improved Formability, Required Hardness, Solution Hardened, and Bake Hardenable; 2023, with Editorial Revision.
- C. ASTM C920 - Standard Specification for Elastomeric Joint Sealants; 2018.
- D. ASTM D522/D522M - Standard Test Methods for Mandrel Bend Test of Attached Organic Coatings; 2017 (Reapproved 2021).
- E. ASTM E84 - Standard Test Method for Surface Burning Characteristics of Building Materials; 2023d.
- F. SEFA 2 - Installations; 2010.
- G. SEFA 3 - Laboratory Work Surfaces; 2020.
- H. SEFA 7 - Laboratory Fixtures; 2021.
- I. SEFA 8M - Laboratory Grade Metal Casework; 2020.

1.4 ADMINISTRATIVE REQUIREMENTS

- A. Coordination: Coordinate installation of casework with related items.
- B. Service Fixtures: Coordinate location and characteristics of service connections.
- C. Preinstallation Meeting: Conduct a preinstallation meeting one week prior to the start of the work of this section; require attendance by all affected installers.
- D. Keying Conference: Conduct conference prior to ordering keys. Incorporate conference decisions into keying submittal.

1.5 SUBMITTALS

- A. See Section 01 30 00 - Administrative Requirements for submittal procedures.

- B. Shop Drawings: Indicate casework types, sizes, and locations, using large scale plans, elevations, and cross sections. Include rough-in and anchors and reinforcements placement dimensions and tolerances, clearances required, and utility locations, if any. Include coordinated information for laboratory equipment specified in another section and/or furnished by Owner.
- C. Test Reports: Independent laboratory reports showing compliance with chemical and physical resistance requirements for casework finish.
- D. Maintenance Data: Manufacturer's recommendations for care and cleaning.
- E. Finish touch-up kit for each type and color of materials provided.

1.6 QUALITY ASSURANCE

- A. Manufacturer Qualifications: Company specializing in manufacturing the products specified in this section with minimum three years of documented experience.
- B. Installer Qualifications: Company specializing in performing work of the type specified in this section, with not less than three years of documented experience and approved by manufacturer.

1.7 DELIVERY, STORAGE, AND HANDLING

- A. Protect items provided by this section, including finished surfaces and hardware items during handling and installation. For metal surfaces, use polyethylene film or other protective material standard with the manufacturer.

1.8 MOCK-UPS

- A. Provide full size base cabinet complete with drawers, door, adjustable shelf and countertop.
- B. See Section 01 40 00 - Quality Requirements for additional requirements.
- C. Locate where directed.
- D. Mock-up may remain as part of the work.

1.9 WARRANTY

- A. See Section 01 78 00 - Closeout Submittals for additional warranty requirements.
- B. Manufacturer Warranty: Provide 5-year warranty against defects. Complete forms in Owner's name and register with manufacturer. Covered defects include, but are not limited to:
 - 1. Ruptured, cracked, or stained finish coating.
 - 2. Discoloration, or lack of finish integrity.
 - 3. Cracking or peeling of finish.
 - 4. Weld or any other structural failure.
 - 5. Failure of hardware.

PART 2 PRODUCTS

2.1 MANUFACTURERS

- A. Metal Laboratory Casework:
 - 1. Bedcolab Ltd: www.bedcolab.com/#sle.
 - 2. CiF Lab Solutions LP: www.cifsolutions.com/#sle. Basis of Design.
 - 3. Substitutions: See Section 01 60 00 - Product Requirements.

2.2 METAL LABORATORY CASEWORK

- A. Casework: Die-formed metal sheet; each unit self-contained and not dependent on adjacent units or building structure for rigidity; factory-fabricated, factory-assembled, and factory-finished.
 - 1. Style: Flush overlay - square edge.
 - 2. Steel Sheet Metal:
 - a. Gables, Front and Back Panels, Gusset Plates, Aprons, and Rails: 18 gauge, 0.0478 inch minimum thickness.
 - b. Drawers, Cabinet Floors, Shelves, Filler Panels and Drawer Dividers: 20 gauge, 0.0359 inch minimum thickness.
 - c. Backing Sheet to Door and Door Fronts: 22 gauge, 0.0299 inch minimum thickness.
 - 3. Structural Performance: In addition to the requirements of SEFA 3, SEFA 7 and SEFA 8M, provide components that safely support the following minimum loads, without deformation or damage:
 - a. Base Units: 500 pounds per linear foot across the cabinet ends.
 - 4. Corners and Joints: Without gaps or inaccessible spaces or areas where dirt or moisture could accumulate.
 - 5. Edges and Seams: Smooth. Form counter tops, shelves, and drain boards from continuous sheets.
 - 6. Shelf Edges: Turned down 3/4 inch on each side and returned 3/4 inch front and back.
 - 7. Ends: Close open ends with matching construction.
 - 8. Welding: Electric spot welded; joints ground smooth and flush.
 - 9. Drawers and Doors: Fabricate drawer and door fronts of sandwiched sheets of sheet steel welded together and reinforced for hardware.
 - a. Fill with sound-deadening core.
 - 10. Stainless Steel Finish: No.4, brushed finish.
 - 11. Separation: Use bituminous paint or non-conductive tape to coat metal surfaces in contact with cementitious materials, and to separate dissimilar metals.
- B. Wall Shelving: At locations indicated.
 - 1. Adjustable Shelf Supports: Standard back-mounted system using single-slotted surface mounted stainless steel shelf standards, in lengths indicated, with coordinated cantilevered shelf brackets, No.4 finish, designed for nominal 1 inch spacing adjustments.
 - 2. Shelves: 3/4 inch thick epoxy resin shelves in lengths indicated.
 - a. Depth: 12 inches.

2.3 CABINET HARDWARE

- A. Manufacturer's standard styles, and as indicated below.
- B. Finish of exposed stainless steel components: No.4 finish.
- C. Locks: On casework drawers and doors, where indicated. Lock with 5 pin cylinder and 2 keys per lock.
 - 1. Hinged Doors: Cam type lock, bright chromium plated over nickel on base material.
 - 2. Framed Sliding Doors: Plunger-type sliding showcase lock, bright chromium plated over nickel on base material.
 - 3. Tall Hinged Doors: Three-point latching system.
 - 4. Keying: Key locks alike within a space; key each room separately.
 - 5. Master Key System: All locks operable by master key.
- D. Label Holders: Manufacturer's standard, sized to hold standard label cards for drawer fronts and cabinet doors indicated, stainless steel with No.4 finish.
- E. Shelves in Cabinets:
 - 1. Shelf Standards and Rests: Vertical standards with rubber button fitted rests, satin chromium plated over nickel on base material.
- F. Wall-Mounted Shelving:
 - 1. Shelf Brackets: Vertical chrome steel standards with chrome steel arms.

- G. Swinging Doors:
 - 1. Hinges: Offset pin, number as required by referenced standards for width, height, and weight of door.
 - 2. Catches: Magnetic.
 - 3. Pulls: Chrome-plated brass wire pulls, 4 inches wide.
- H. Drawers:
 - 1. Pulls: Brass wire pulls, 4 inches wide.
 - 2. Slides: Steel, full extension arms, ball bearings; self-closing; capacity as recommended by manufacturer for drawer height and width.

2.4 COUNTERTOPS

- A. Countertops: See Section 12 36 00.

2.5 MATERIALS

- A. Sheet Steel: High-strength low-alloy, cold rolled and leveled unfinished steel sheet, ASTM A1008/A1008M, Class 1 (matte) finish.
- B. Stainless Steel Sheet: ASTM A666/A666M, Type 304.

2.6 FINISHES

- A. Sheet Steel Finish: Having chemical resistance equal to Level 0 (no change) or Level 1 (slight change of gloss or slight discoloration) according to SEFA 8M. Test applied finishes using procedures specified in ASTM D522/D522M.
 - 1. Coating Type, New Casework: Baked on epoxy; minimum two coats.
 - 2. Color: Standard Black.
 - 3. Preparation: Degrease and phosphate etch, and prime.

PART 3 EXECUTION

3.1 EXAMINATION

- A. Verify adequacy of support framing and anchors.
- B. Verify that service connections are correctly located and of proper characteristics.

3.2 INSTALLATION

- A. Perform installation in accordance with manufacturer's instructions and with SEFA 2.
- B. Use anchoring devices to suit conditions and substrate materials encountered. Use concealed fasteners to the greatest degree possible. Use exposed fasteners only where allowed by approved shop drawings, or where concealed fasteners are impracticable.
- C. Set casework items plumb and square, securely anchored to building structure, with no distortion.
 - 1. Base Cabinets: Examine floor levelness and flatness of installation space. Do not proceed with installation if encountered floor conditions required more than 3/4 inch leveling adjustment. When installation conditions are acceptable, for each space, establish the high point of the floor. Set and make level and plumb first cabinet in relation to this high point.
- D. Align cabinets to adjoining components, install filler and/or scribe panels where necessary to close gaps.
- E. Fasten together cabinets in continuous runs, with joints flush, uniform and tight. Misalignment of adjacent units not to exceed 1/16 inch. In addition, do not exceed the following tolerances:

1. Variation of Tops of Base Cabinets from Level: 1/16 inch in 10 feet.
2. Variation of Faces of Cabinets from a True Plane: 1/8 inch in 10 feet.
3. Variation of Adjacent Surfaces from a True Plane (Lippage): 1/32 inch.
4. Variation in Alignment of Adjacent Door and Drawer Edges: 1/16 inch.

- F. Separate dissimilar metals to prevent galvanic action.
- G. Base Cabinets: Fasten cabinets to service space framing and/or wall substrates, with fasteners spaced not more than 16 inches on center. Bolt adjacent cabinets together with joints flush, tight, and uniform.
- H. Install hardware uniformly and precisely. Set hinges snug and flat in mortises.
- I. Replace units that are damaged, including those that have damaged finishes.

3.3 ADJUSTING

- A. Adjust operating parts, including doors, drawers, hardware, and fixtures to function smoothly.

3.4 CLEANING

- A. Clean casework and other installed surfaces thoroughly.

3.5 PROTECTION

- A. Do not permit finished casework to be exposed to continued construction activity.
- B. Protect casework and countertops from ongoing construction activities. Prevent installers from standing on or storing tools and materials on casework or countertops.
- C. Repair damage that occurs prior to Date of Substantial Completion, including finishes, using methods prescribed by manufacturer; replace units that cannot be repaired to like-new condition.

END OF SECTION



PHOTOS OF EXISTING CONDITIONS

ALL LOOSE SHELVING AND FURNITURE
PIECES AROUND THE PLAY GYM TO BE
REMOVED BY OWNER

ALL EXPOSED WOOD SURFACES TO BE
CLEANED/PREPED AND REFINISHED.
PROVIDE CUSTOM WOOD STAIN AND
FINISH REFER TO 06 41 00 FOR FINISH
INFORMATION PARTIALLY DISASSEMBLE
AS REQUIRED TO COMPLETE WORK

REMOVE EXISTING CARPET TILE IN ITS
ENTIRETY. PREP FOR NEW CARPET TILE.
PROVIDE CARPET TILE TO MATCH
PLATFORM CARPET FINISH FOR PRE-K RM
252 FLOORING TYP. REFER TO FINISH
SCHEDULE FOR ADDITIONAL INFORMATION.

EXISTING CUSTOM 8'-4" x 8'-4"
RAISED WOODEN PLAYGYM



MATCH STAIN W/ CASEWORK
STAIN. SEE FINISH SCHEDULE FOR
ADDITIONAL INFORMATION.

1 REFURBISHED PLAYGYM VIEW

ADDITIONAL REFERENCE MATERIAL PLAYGYM

**2025 CAPITAL IMPROVEMENT PROJECT
PRATTSBURGH CENTRAL SCHOOL DISTRICT**

1 ACADEMY STREET, PRATTSBURGH, NY 14873

Copyright 2026

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
HORSEHEADS, NY 607 - 358 - 1000 ROCHESTER, NY 585 - 327 - 7949
TOWANDA, PA 570 - 265 - 4868

AD3-A1

DATE:
3/4/2026

PROJECT NO:
2716-043

FAN SCHEDULE

FAN #	LOCATION	CFM	MODEL	RPM	ELECTRICAL			SONES	SP	DRIVE	REMARKS & NOTES
					HP	VOLTS	PHASE				
AG-EF-1	AG-H1.1	450	120C28DOR70VF	1901	.358	120 V	1	15.9	.75	DIRECT	COOK 1,2,3,4
AG-EF-2	GREENHOUSE	1500	120SQNX17D	1705	.5	120 V	1	13	.5	DIRECT	COOK 1,4,5

- NOTES: 1. PROVIDE FACTORY DISCONNECT SWITCH.
 2. PROVIDE 18" WIND RATED ROOF CURB.
 3. PROVIDE MOTORIZED BACKDRAFT DAMPER.
 4. START/STOP BY DDC.
 5. PROVIDE ECM MOTOR FOR SPEED CONTROL.

UNIT HEATER SCHEDULE

UNIT #	LOCATION	HEATING COIL DATA					ELECTRICAL			MODEL #	NOTES	
		CFM	LAT	EWT	GPM	WPD MAX.	CAP MBH	HP	VOLTS			PHASE
UH-1	GREENHOUSE	700	97	160	4.5	0.17	28.03	1/20	120	1	TRANE HS-60	1


- NOTES: 1. UNIT FURNISHED WITH FACTORY WIRED DISCONNECT

DEMOLITION NOTES - MECHANICAL


- D1 REMOVE UNIT HEATER, DISCONNECT AND REMOVE PIPING BACK AND ALL ASSOCIATED ACCESSORIES BACK TO CLASSROOM CEILING, PRICE AS 30 FEET OF TOTAL PIPE REMOVAL. REMOVE CONTROLS AND PREPARE FOR NEW WORK.
 D2 DISCONNECT AND REMOVE WALL MOUNTED INLINE FAN. PREPARE FOR NEW WORK.

CONSTRUCTION NOTES MECHANICAL


- 1 PROVIDE UNIT HEATER AS SCHEDULED. EXTEND AND RECONNECT HWS&R PIPING FROM CLASSROOM CEILING. PROVIDE NEW TEMPERATURE CONTROLS.
 2 PROVIDE INLINE FAN AS SCHEDULED WITH WIRE FAN GUARD AND RECONNECT TO EXISTING WALL OPENING.
 3 PROVIDE NEW DAMPER ACTUATOR AND INTERLOCK CONTROL WITH OPERATION OF AG-EF-2.

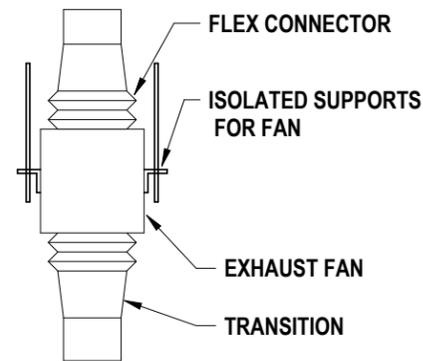


4 **INLINE FAN DETAIL**
N.T.S.

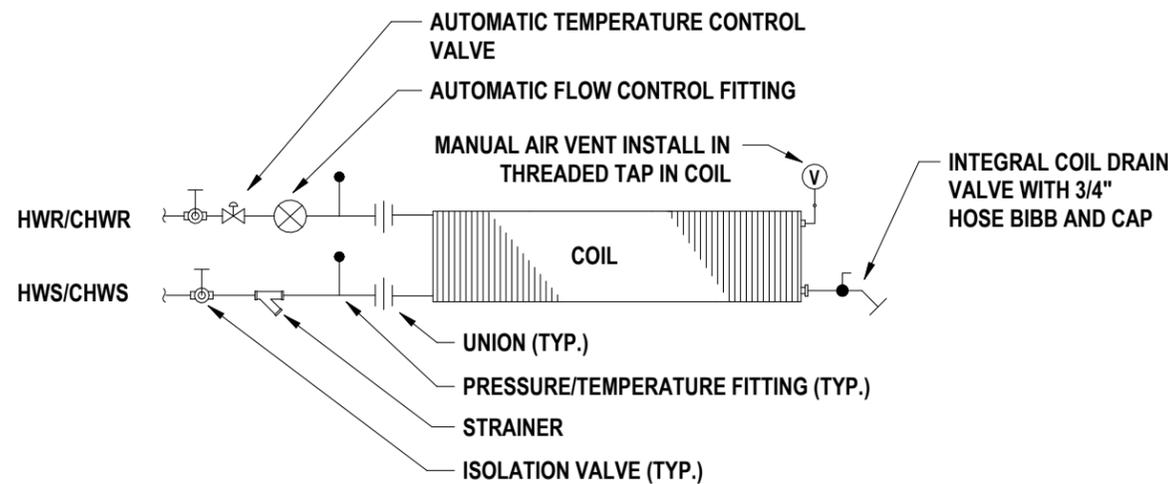

3 **TYPICAL 2-WAY COIL PIPING SCHEMATIC (HEATING/COILING)**
N.T.S.

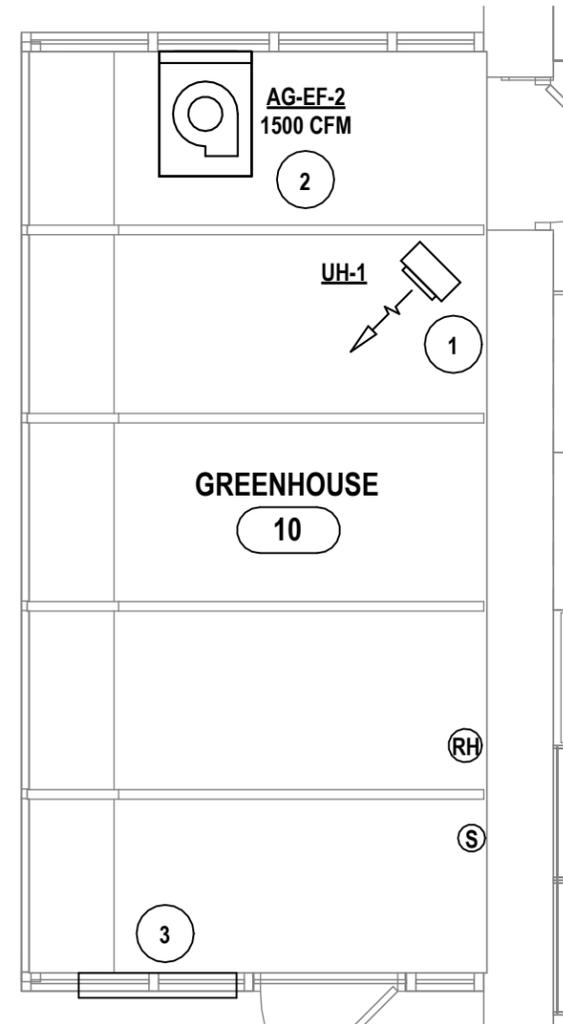

2 **FIRST FLOOR HVAC PLAN - GREENHOUSE**
1/4" = 1'-0"

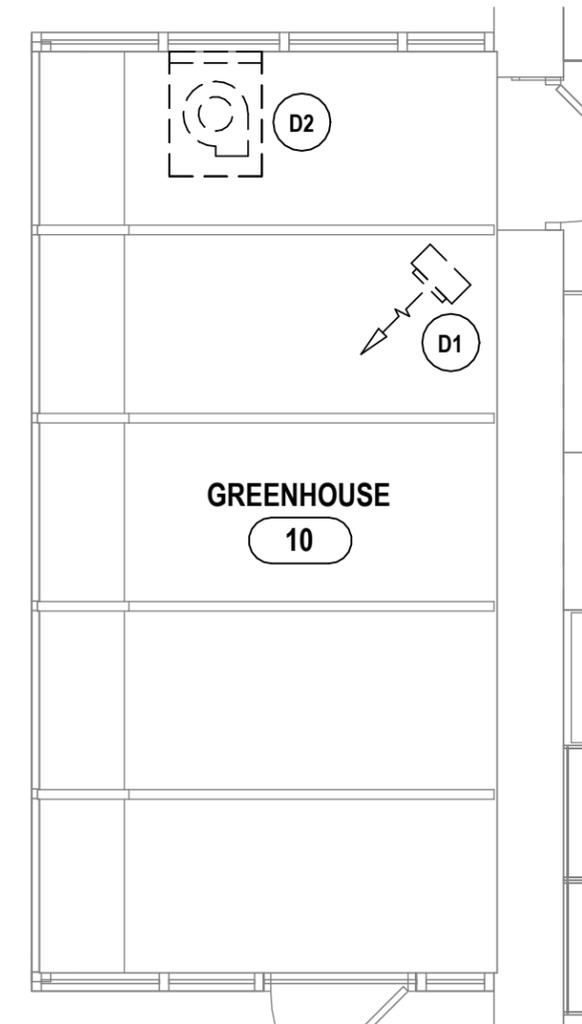

1 **FIRST FLOOR HVAC DEMOLITION PLAN - GREENHOUSE**
1/4" = 1'-0"

DRAWN BY: KMM
 CHECKED BY: ENS
 DATE: 03/09/20

"IT IS A VIOLATION OF THE LAW FOR ANY PERSON TO MAKE UNAUTHORIZED ALTERATIONS OR ADDITIONS TO PLANS BEARING A LICENSED ENGINEER'S, ARCHITECT'S OR SURVEYOR'S SEAL."

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
 ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
 TOWANDA, PA - WILLIAMSPORT, PA
 WWW.HUNT-EAS.COM 607-358-1000
 NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

GREENHOUSE MECHANICAL PLANS
 2025 CAPITAL IMPROVEMENT PROJECT
 PRATTSBURGH CENTRAL SCHOOL DISTRICT
 PRATTSBURGH, NEW YORK

AD3-H1

PROJECT NO: 2716-043


GENERAL NOTES:

- A THE CONTRACTOR IS RESPONSIBLE FOR ALL WORK REQUIRED TO IMPLEMENT THE WORK OF THE CONTRACT, REGARDLESS OF WHETHER SPECIFICALLY INDICATED OR NOT, UNLESS NOTED OTHERWISE.
- B THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND EXISTING CONDITIONS IN FIELD BEFORE COMMENCING ANY WORK AND NOTIFY ARCHITECT IMMEDIATELY IF ANY DISCREPANCIES ARE FOUND.
- C THE CONTRACTOR SHALL COORDINATE THE WORK OF THIS CONTRACT WITH THE WORK OF THE OTHER TRADES.
- D ALL NEW DOOR FRAMES INSTALLED IN METAL STUD OR MASONRY PARTITIONS SHALL BE MOUNTED 4" FROM ADJACENT WALLS (6" TO DOOR). TOOTH IN CMU BLOCK AND ANCHORS AT DOORS IN EXISTING CMU WALLS, UNLESS NOTED OR DETAILED OTHERWISE, WHERE NEW DOORS ARE LOCATED IN EXISTING CORRIDORS, FLOORING SHALL BE PATCHED TO MATCH EXISTING OR NEW CORRIDOR FLOORING.
- E INSTALL SOLID WOOD BLOCKING IN METAL STUD WALLS AT ALL AREAS OF CASEWORK, PANELING, TACK/MARKER BOARDS, TOILET ACCESSORIES AND ALL WALL MOUNTED EQUIPMENT AND ACCESSORIES.
- F ALL EXISTING BRICK VENEER SCHEDULED FOR DEMOLITION IS TO BE REMOVED WITH CARE, SALVAGED, CLEANED AND STORED FOR RE-USE (TOOTH PATCHING) IN DIFFERENT LOCATIONS OF THE EXISTING BUILDING.
- G ITEMS SHOWN ARE INTENDED TO GIVE APPROXIMATE QUANTITY, LOCATION & TYPE. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ACTUAL QUANTITY & EXISTING FIELD CONDITIONS.
- H VERIFY WITH OWNER EXACT SIZE OF ALL EQUIPMENT FURNISHED BY OWNER FOR PROPER FIT WITH CONTRACTOR SUPPLIED CASEWORK AND MILLWORK.
- I ALL DIMENSIONS ARE TAKEN FROM FACE OF WALL TO FACE OF WALL, UNLESS NOTED OTHERWISE.
- J THERE SHALL BE A MINIMUM OF 1'-6" CLEAR FLOOR SPACE ON THE PULL SIDE OF ALL NEW DOORS; THERE SHALL BE A MINIMUM OF 1'-0" CLEAR FLOOR SPACE ON THE PUSH SIDE OF ALL NEW DOORS.
- K THE WHEEL CHAIR SYMBOL INDICATES HANDICAP ACCESSIBLE MOUNTED FIXTURE ELEVATION AND SHALL CONFORM WITH CABOANSI A117.1 AND ADAAG.
- L INFILL EXISTING MASONRY OPENINGS TO MATCH EXISTING WALL CONSTRUCTION & THICKNESS, UNLESS NOTED OTHERWISE. TOOTH IN NEW OR SALVAGED MASONRY WITH EXISTING. MATCH EXISTING FINISHES OR PREPARE SUBSTRATE AS REQUIRED TO ACCEPT NEW FINISHES.
- M EXTEND ALL NEW PARTITIONS TO DECK ABOVE UNLESS NOTED OTHERWISE. INSTALL FIRE STOPPING AT DECK FLUTES IN AREAS OF METAL DECKING WHERE FIRE SEPARATION IS REQUIRED.
- N ALL PENETRATIONS THROUGH FIRE RATED PARTITIONS TO BE SEALED W/ APPROVED U.L. FIRE RATED ASSEMBLIES.
- O FILL ALL VOIDS AND IMPERFECTIONS IN WALLS AND FLOORS CREATED BY DEMOLITION. PATCH TO MATCH EXISTING & PREPARE TO RECEIVE NEW FINISHES.
- P MAINTAIN ALL EXISTING FIRE SEPARATIONS, REFER TO CODE COMPLIANCE SHEET FOR LOCATIONS OF SEPARATIONS.
- Q THE CONTRACTOR SHALL PROVIDE TEMPORARY FIRE RATED PARTITIONS AS INDICATED ON DRAWINGS AND AS DIRECTED BY THE ARCHITECT TO SEPARATE CONSTRUCTION AREAS FROM OWNER OCCUPIED AREAS. KEEP ALL EXITS FREE AND CLEAR AT ALL TIMES DURING HOURS OF OPERATION. BARRIER LOCATIONS SHALL BE SUBJECT TO ARCHITECT'S APPROVAL.
- R THE CONTRACTOR SHALL PROVIDE ALL ROOF OPENINGS FOR DUCT WORK/HVAC EQUIPMENT UNLESS NOTED OTHERWISE. THE CONTRACTOR SHALL INSTALL ROOF CURBS, BLOCKING, SUPPLEMENTAL STEEL FRAMING, PROVIDE AND INSTALL ALL PIPE BOOTS/PIPE RAILS AND FLASHING. REFER TO "H", "P" AND "E" DRAWINGS FOR EXACT LOCATIONS. THE CONTRACTOR SHALL COORDINATE ALL ROOF OPENINGS WITH OTHER TRADES.
- S THE CONTRACTOR SHALL PROVIDE ALL STEEL LINTELS REQUIRED AT MASONRY OPENINGS. REFER TO HVAC DRAWINGS FOR EXACT OPENING LOCATIONS IN MASONRY WALLS FOR HVAC EQUIPMENT.
- T THE CONTRACTOR SHALL INSTALL AND SEAL ALL EXTERIOR LOUVERS SUPPLIED BY THE HVAC CONTRACTOR. REFER TO HVAC DRAWINGS FOR EXACT SIZE, QUANTITY AND LOCATIONS.


PLAN DRAWING NOTES:

- 1 NEW WATER FOUNTAIN AND BOTTLE FILLING STATION AS SHOWN. REFER TO P-DWGS FOR MORE INFO.
- 2 NEW SERVICE SINK AS SHOWN. SEE P-DWGS FOR MORE INFO.
- 3 REINSTALLED PRESERVED GLAZING AFTER CLEANED AND PREPPED FOR INSTALLATION.
- 4 CLEAN, PREP AND PAINT EXISTING STRUCTURAL GREENHOUSE FRAMING, UNISTRUT, AND HARDWARE.
- 5 PROVIDE NEW HIGH PRIVACY STAINLESS STEEL GAPLESS TOILET PARTITIONS TYP.
- 6 PROVIDE HANDICAP ACCESSIBLE GRAB BARS AND TOILET ROOM ACCESSORIES AS SHOWN ON PLANS.
- 7 REINSTALL BATHROOM SIGNAGE. REFER TO AG-A8.1 FOR ADDITIONAL INFORMATION.


TOILET ROOM ACCESSORY SCHEDULE					
SYMBOL	DESCRIPTION	MANUFACT.	MODEL	SIZE	REMARKS
	TOILET TISSUE DISPENSER	AMERICAN SPECIALTIES INC.	74022-HB5M	--	FURNISHED BY OWNER. INSTALLED BY CONTRACTOR.
1A	GRAB BAR	AMERICAN SPECIALTIES INC.	3800	36"	HORIZONTAL PROVIDED BY CONTRACTOR
1B	GRAB BAR	AMERICAN SPECIALTIES INC.	3800	42"	HORIZONTAL PROVIDED BY CONTRACTOR.
1C	GRAB BAR	AMERICAN SPECIALTIES INC.	3800	18"	VERTICAL PROVIDED BY CONTRACTOR.
2	TOILET TISSUE DISPENSER	PROVIDED BY OWNER	--	FIELD VERIFY	FURNISHED BY OWNER. INSTALLED BY CONTRACTOR.
3	PAPER TOWEL DISPENSER	PROVIDED BY OWNER	--	FIELD VERIFY	FURNISHED BY OWNER. INSTALLED BY CONTRACTOR.
4	MIRROR	AMERICAN SPECIALTIES INC.	#600 SERIES	16" X 24"	PROVIDED BY CONTRACTOR.
5	SOAP DISPENSER	PROVIDED BY OWNER	--	FIELD VERIFY	FURNISHED BY OWNER. INSTALLED BY CONTRACTOR.
6	SANITARY NAPKIN DISPOSAL	PROVIDED BY OWNER	--	FIELD VERIFY	FURNISHED BY OWNER. INSTALLED BY CONTRACTOR.
7	ELECTRIC HAND DRYER	PROVIDED BY OWNER	--	FIELD VERIFY	FURNISHED BY OWNER. INSTALLED BY CONTRACTOR.
8	URINAL SCREEN	GLOBAL PARTITIONS	HDPE	18" X 48"	PROVIDED BY CONTRACTOR.
9	SURFACE MOUNTED WASTE RECEPTACLE	AMERICAN SPECIALTIES INC.	10-0458-9	17 1/4" X 30 1/2" X 8"	PROVIDED BY CONTRACTOR

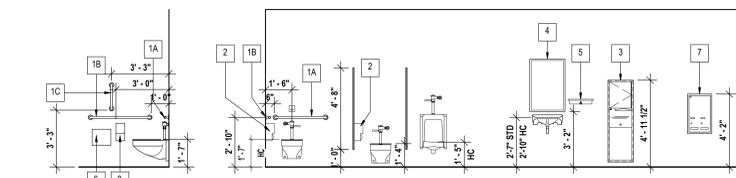


10 AS - TYPICAL MOUNTING HEIGHT - TOILET ACCESSORIES
1/4" = 1'-0"




9 MEN'S RR ELEVATION - D
1/4" = 1'-0"

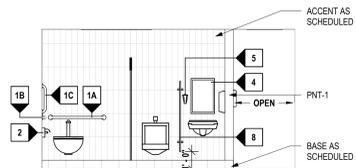


8 MEN'S RR ELEVATION - C
1/4" = 1'-0"




7 MEN'S RR ELEVATION - B
1/4" = 1'-0"

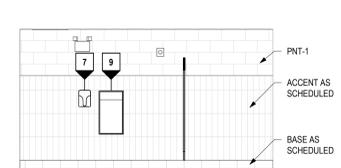


6 MEN'S RR ELEVATION - A
1/4" = 1'-0"




5 WOMEN'S RR ELEVATION - D
1/4" = 1'-0"

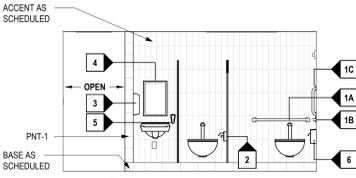


4 WOMEN'S RR ELEVATION - C
1/4" = 1'-0"



3 WOMEN'S RR ELEVATION - B
1/4" = 1'-0"

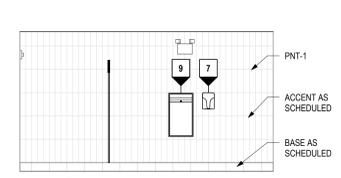

2 WOMEN'S RR ELEVATION - A
1/4" = 1'-0"

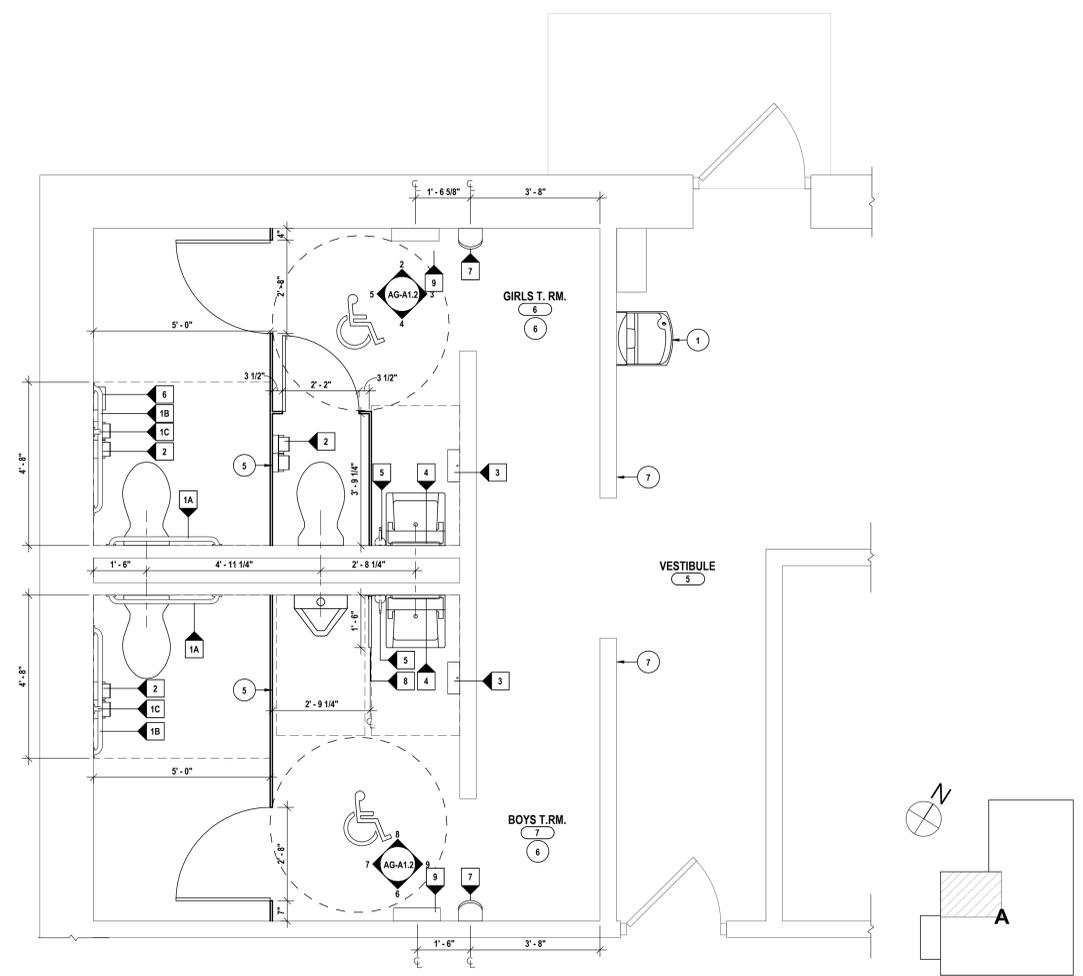

1 ENLARGED RESTROOM PLAN
1/2" = 1'-0"

Main Building - SEDR 57-23-01-04-001-034 - Dugout with storage - SEDR 57-23-01-04-200-001 - Auxiliary Building - SEDR 57-23-01-04-002-012 - Agricultural Building - SEDR 57-23-01-04-008-012 - Toilet Room Facility - SEDR 57-23-01-04-7-012-001

HUNT ENGINEERS ARCHITECTS | SURVEYORS
HORSEHEADS, NY 607-263-1000 ROCHESTER, NY 562-337-7668 TOYAHVALD, PA 670-265-4668
BINGHAMTON, NY 607-798-8881 ALBANY, NY 607-798-8881 WWW.HUNTEAS.COM
NY CERTIFICATE NO. 0019250 PA CERTIFICATE NO. TSC22020313464-1

ENLARGED RESTROOM PLAN, ELEVATIONS AND SCHEDULES
2025 CAPITAL IMPROVEMENT PROJECT
PRATTSBURGH CENTRAL SCHOOL DISTRICT
PRATTSBURGH, NEW YORK
AG-A1.2
PROJECT NO: 2716-043

DRAWN BY: TSK
CHECKED BY: JDI
DATE: 12/18/2025
PHASE: CD
COPYRIGHT 2025

DESCRIPTION OF REVISION:
ISSUED FOR BID
DATE: 1 10/08/2025
TT IS A VIOLATION OF THE LAW FOR ANY PERSON TO MAKE UNAUTHORIZED ALTERATIONS OR ADDITIONS TO PLANS DRAWING, CALCULATIONS, SPECIFICATIONS, PROJECTS OR CONTRACTS MADE.